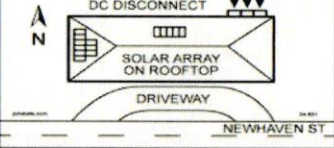



2020 NEC Labeling Requirements

NEC Section	Location of Label	Label Text and Appearance	NEC Section	Location of Label	Label Text and Appearance
690.54	All interactive system(s) points of interconnection with other sources shall be marked at an accessible location at the disconnecting means as a power source and with the rated ac output current and the nominal operating ac voltage.	PHOTOVOLTAIC AC DISCONNECT MAXIMUM AC OPERATING CURRENT: _____ NOMINAL OPERATING AC VOLTAGE: _____	690.13(B) 690.15(C)	Where all terminals of the disconnecting means may be energized in the open position, a warning sign shall be mounted on or adjacent to the disconnecting means.	WARNING ELECTRICAL SHOCK HAZARD TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION
690.56(B) 690.4(D) 705.10	A permanent plaque or directory shall be installed at each service equipment location, or at an approved readily visible location. The plaque or directory shall denote the location of each power source disconnecting means for the building or structure and be grouped with other plaques or directories for other on-site sources. The plaque or directory shall be marked with the wording "CAUTION: MULTIPLE SOURCES OF POWER." Any posted diagrams shall be correctly oriented with respect to the diagram's location. The marking shall comply with 110.21(B).	Caution: MULTIPLE SOURCES OF POWER WITH DISCONNECTS LOCATED AS SHOWN: MAIN SERVICE PANEL AND METER AC DISCONNECT INVERTER WITH DC DISCONNECT 	705.12 (B)(3)(2) 705.12 (B)(3)(3)	A permanent warning label shall be applied to the distribution equipment adjacent to the back-fed breaker from the inverter. Permanent warning labels shall be applied to distribution equipment	WARNING INVERTER OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE. WARNING THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.
690.13(B) 690.15 705.20	Each PV system disconnecting means shall plainly indicate whether in the open (off) or closed (on) position and be permanently marked: "PV SYSTEM DISCONNECT" Or equivalent.	MAIN PHOTOVOLTAIC SYSTEM DISCONNECT PHOTOVOLTAIC DC DISCONNECT PHOTOVOLTAIC AC DISCONNECT	690.56 (C)	Buildings with PV systems shall have a permanent label located at each service equipment location to which the PV systems are connected or at an approved readily visible location and shall indicate the location of rapid shutdown initiation devices. The label shall include a simple diagram of a building with a roof and shall include the following words: The title "SOLAR PV SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN" shall utilize capitalized characters with a minimum height of 3/8 in. in black on yellow background, and the remaining characters shall be capitalized with a minimum height of 3/16 in. in black on white background. (2) A rapid shutdown switch shall have a label located on or no more than 3 ft from the switch that includes this wording. The label shall be reflective, with all letters capitalized and having a minimum height of 3/8 in., in white on red background.	SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUTDOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN ARRAY 
690.53	A permanent readily visible label indicating the highest maximum dc voltage in a PV system, calculated in accordance with 690.7, shall be provided by the installer at one of the three locations.	MAXIMUM DC VOLTAGE _____ OF PV SYSTEM			RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM
690.31 (D)(2)	Unless the purpose is evident, the following wiring methods and enclosures that contain PV system dc circuit conductors shall be marked: (1) Exposed raceways, cable trays, and other wiring methods (2) Covers or enclosures of pull boxes and junction boxes (3) Conduit bodies in which any of the available conduit openings are unused	SOLAR PV DC CIRCUIT PHOTOVOLTAIC POWER SOURCE		(1) Buildings with More Than One Rapid Shutdown Type. For buildings that have PV systems with both rapid shutdown types or a PV system with a rapid shutdown type and a PV system with no rapid shutdown, a detailed plan view diagram of the roof shall be provided showing each different PV system and a dotted line around areas that remain energized after the rapid shutdown switch is operated.	